

March 24, 2022

Summer Village of Sandy Beach  
Range Road 1, Site 1, Comp 63  
Onoway, Alberta, T0E 1V0

Dear:

**Request for Municipal Approval Regarding Electric Distribution Facilities**

**Re:** 500098322

**Description of Work:** Residential - FortisAlberta to Install: -Transformer specs/ Equipment included - 15kVA (14.4kV/120/240V) -new pole and two anchors Salvage summary: -1 Pole - 49m secondary conductor -2 anchors -Dead-end primary on existing pole. - NW 35-55-01-W5

FortisAlberta is proposing to salvage and install electric distribution facilities as indicated on the attached print(s). This letter is a formal request for written approval from Summer Village of Sandy Beach to proceed with the salvage and install of these facilities within the applicable municipal rights-of-way.

FortisAlberta requires formal approval because either (i) the proposed salvage and install of electric distribution facilities does not meet the conditions of the Electric Distribution System Franchise Agreement held with Summer Village of Sandy Beach, or (ii) FortisAlberta does not currently have an Electric Distribution System Franchise Agreement with Summer Village of Sandy Beach.

If Summer Village of Sandy Beach does not currently hold an Electric Distribution System Franchise Agreement with FortisAlberta and wishes to discuss further, please inform the undersigned.

Please review the attached print(s), indicate the location of any municipal underground facilities in the area and identify any potential conflict with our proposed facilities by mark up on the print(s). Please sign, date and return one copy of your signed approval to FortisAlberta by April 7, 2022.

Re: 500098322

If you would like FortisAlberta to contact a municipal representative prior to construction, please provide the contact information below:

Contact: \_\_\_\_\_

Phone: \_\_\_\_\_ Cell Phone: \_\_\_\_\_

We appreciate your cooperation with us in this regard. If you have any questions or concerns regarding the work outlined in this request for approval, please contact the undersigned.

Sincerely,



**Reviewed and Approved by**

**Summer Village of Sandy Beach**


**Rudolf Liebenberg,**  
[Name]

**2022-03-25,**  
[Date]

**Chief Administrative Officer on behalf of**  
[Position]

*Rudolf Liebenberg*  
[Signature]


# Location Map

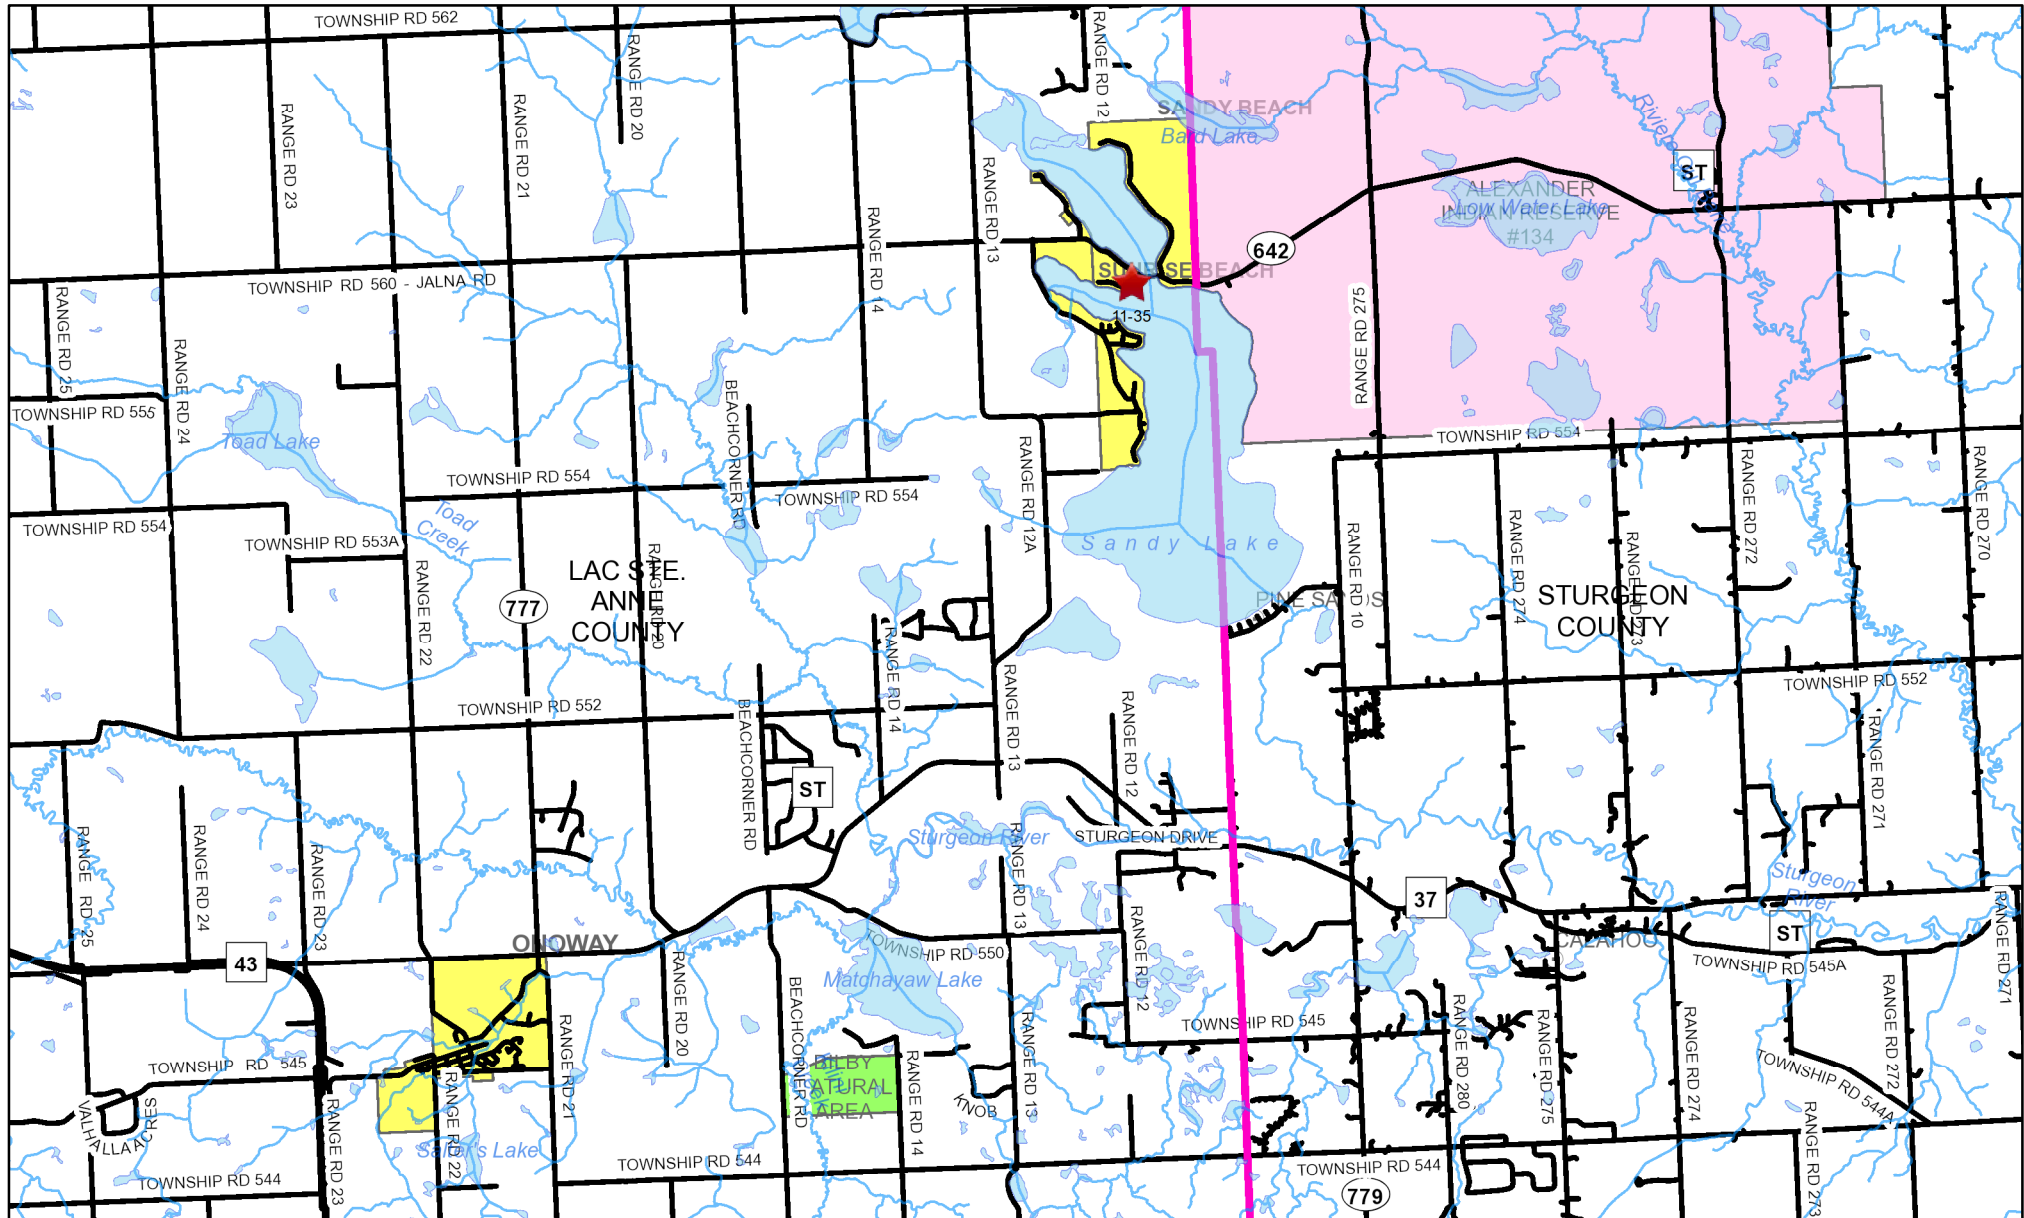


Tuesday, November 16, 2021








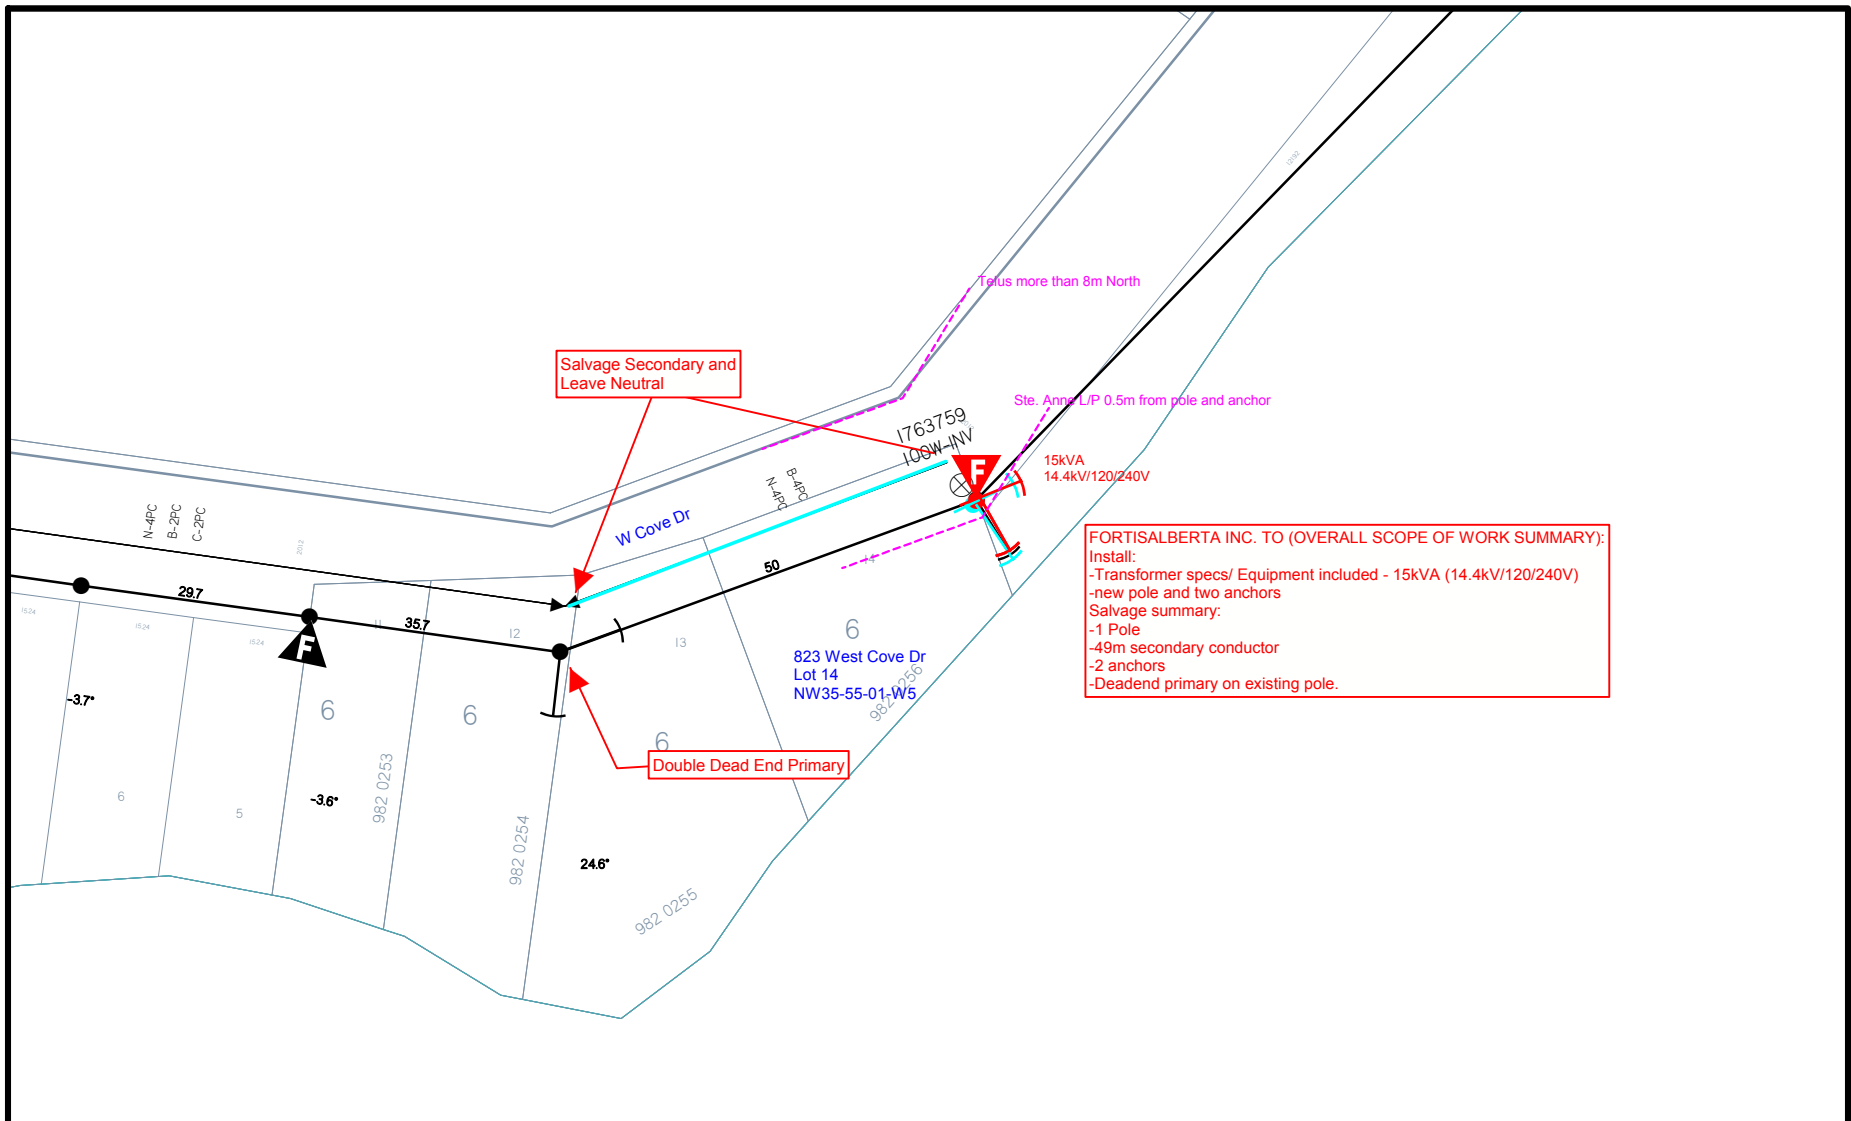1:106,041

0 4,050 8,100 16,200 ft






**FORTISALBERTA INC. TO (OVERALL SCOPE OF WORK SUMMARY):**  
 Install:  
 -Transformer specs/ Equipment included - 15kVA (14.4kV/120/240V)  
 -new pole and two anchors  
 Salvage summary:  
 -1 Pole  
 -49m secondary conductor  
 -2 anchors  
 -Deadend primary on existing pole.

NOTES:			<b>LEGEND:</b> RED  NEW PRIMARY PURPLE  NEW SECONDARY BLUE  SALVAGE GREEN  BRUSHING BLACK  EXISTING FACILITIES
			Designer: Geoffrey Serafico Customer: Mark Carson Location: NW35-55-1-W5 Date: 3/22/2022 WO#/OI#: 65441700

LAND ONLY TO SCALE 1:1,000  
 Print Approval Print

# Pipeline Map

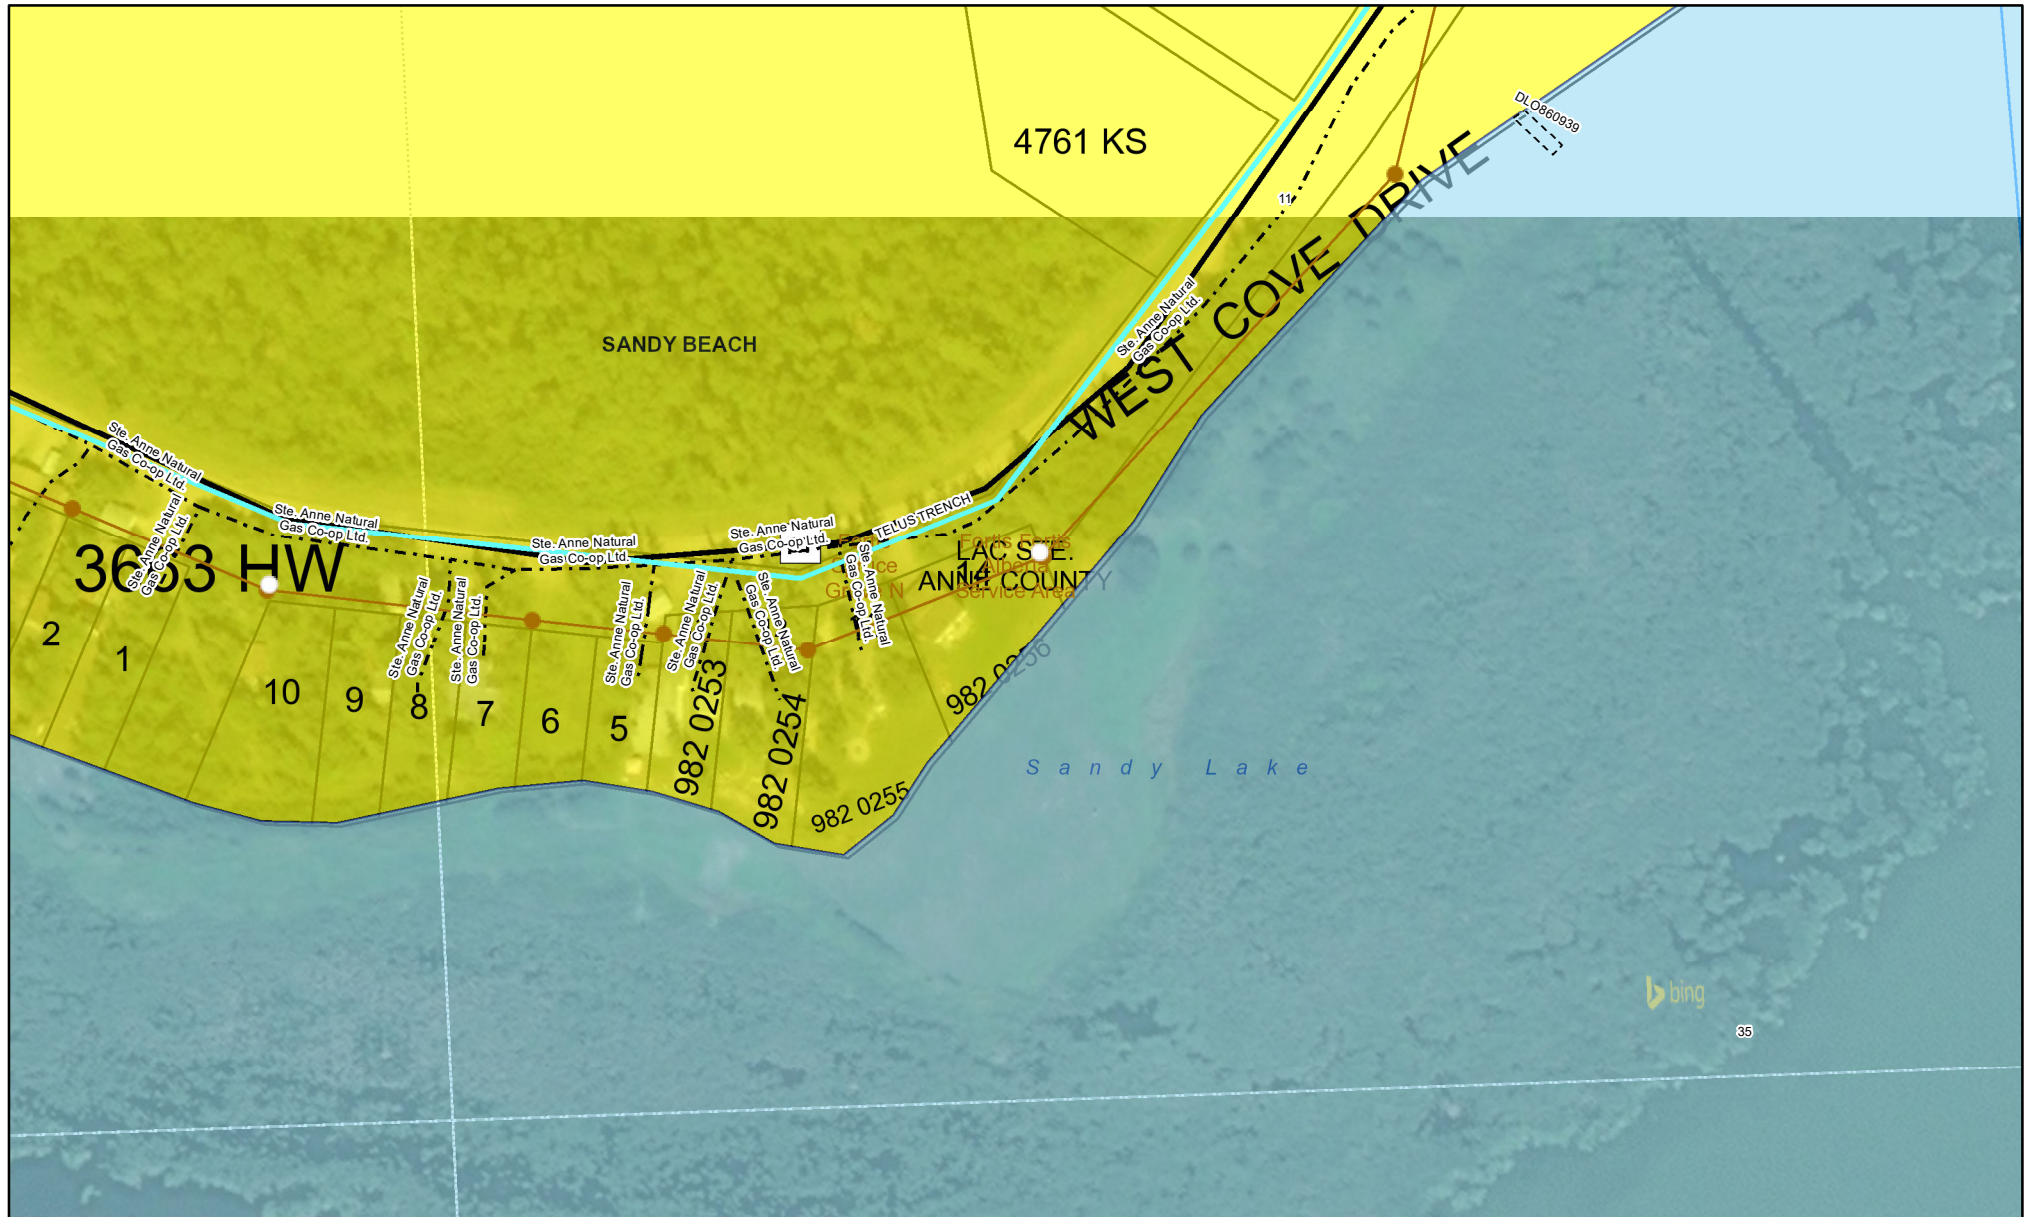

Tuesday, November 16, 2021

1:1,749

0 70 140 280 ft